


## ISIMET – Solenoid Typical Installation for Massachusetts

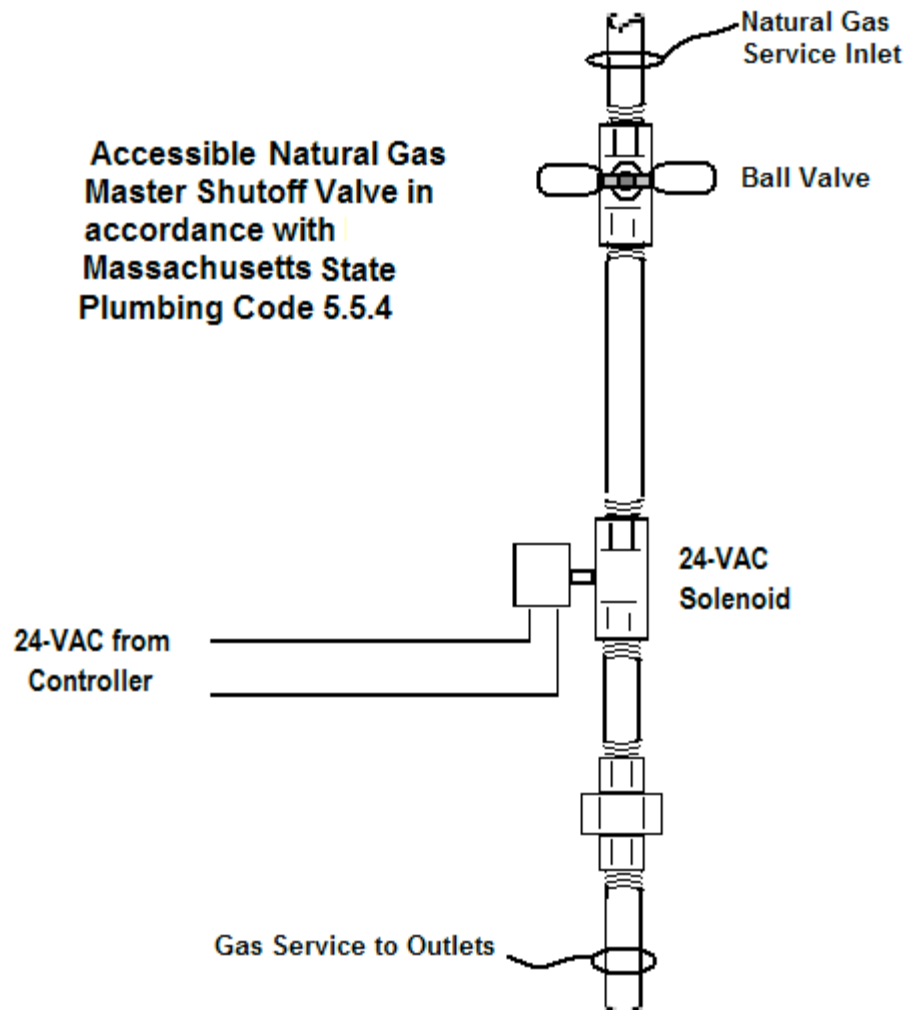

### Code Requirements:

Massachusetts State Plumbing Code 5.5.4 requires a single readily accessible master cutoff valve to be located within a classroom where gas burning laboratory equipment is used by students. One must be provided by the installer. Refer to Figure above for typical field piping assembly. Installation should only be performed by a plumber or gas fitter licensed in the Commonwealth of Massachusetts.